


Single-phase Voltage Relay K8AB-VW

Ideal for voltage monitoring for industrial facilities and equipment.

- Monitor for overvoltages and undervoltages simultaneously. Separate settings and outputs supported for overvoltages and undervoltages.
- Manual resetting and automatically resetting supported by one Relay.
- Pre-alarm Mode (H/HH and L/LL operating modes)
- Two SPDT output relays, 6 A at 250 VAC (resistive load).
- Process control signal (0 to 10 V) and current splitter input supported.
- Relay warning status easily monitoring using LED indicator.
- Input frequency of 40 to 500 Hz supported.
- Easy wiring with ferrules
2 × 2.5 mm² solid or 2 × 1.5 mm² standard ferrules.
- CE mark compliance certified by third party.
UL certification.

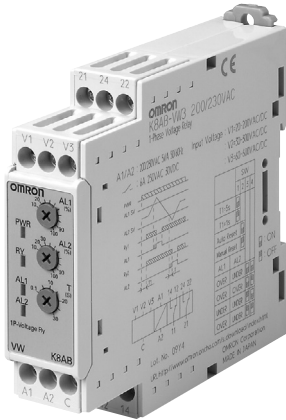

Model Number Structure

■ Model Number Legend


K8AB-

1 2 3 4

- 1. Basic Model**
K8AB: Measuring and Monitoring Relays
- 2. Functions**
VW: Single-phase Voltage Relay (Simultaneous upper and lower limit monitoring)
- 3. Measuring Current**
 - 1: 6 to 60 mV AC/DC, 10 to 100 mV AC/DC, 30 to 300 mV AC/DC
 - 2: 1 to 10 V AC/DC, 3 to 30 V AC/DC, 15 to 150 V AC/DC
 - 3: 20 to 200 V AC/DC, 30 to 300 V AC/DC, 60 to 600 V AC/DC
- 4. Supply Voltage**
 - 24 VDC: 24 VDC
 - 24 VAC: 24 VAC
 - 100-115 VAC: 100 to 115 VAC
 - 200-230 VAC: 200 to 230 VAC

Ordering Information

List of Models

| Single-phase Voltage Relay | Measuring voltage (See note.) | Supply voltage | Model |
|---|--|----------------|----------------------|
|  | 6 to 60 mV AC/DC, 10 to 100 mV AC/DC, 30 to 300 mV AC/DC | 24 VDC | K8AB-VW1 24 VDC |
| | | 24 VAC | K8AB-VW1 24 VAC |
| | | 100-115 VAC | K8AB-VW1 100-115 VAC |
| | | 200-230 VAC | K8AB-VW1 200-230 VAC |
| | 1 to 10 V AC/DC, 3 to 30 V AC/DC, 15 to 150 V AC/DC | 24 VDC | K8AB-VW2 24 VDC |
| | | 24 VAC | K8AB-VW2 24 VAC |
| | | 100-115 VAC | K8AB-VW2 100-115 VAC |
| | | 200-230 VAC | K8AB-VW2 200-230 VAC |
| | 20 to 200 V AC/DC, 30 to 300 V AC/DC, 60 to 600 V AC/DC | 24 VDC | K8AB-VW3 24 VDC |
| | | 24 VAC | K8AB-VW3 24 VAC |
| | | 100-115 VAC | K8AB-VW3 100-115 VAC |
| | | 200-230 VAC | K8AB-VW3 200-230 VAC |

Note: The rated input depends on the connected terminals. Select the terminals suitable for the inputs, and connect the inputs to V1-COM, V2-COM, and V3-COM.

Ratings and Specifications

Ratings

| | | |
|-------------------------|-------------------------------|--|
| Operating power | Non-isolated power supply | 24 VDC (1 W) |
| | Isolated power supply | 24 VAC (4 VA), 100 to 115 VAC (4 VA), 200 to 230 VAC (5 VA) |
| Operation (AL1 and AL2) | Operating value setting range | 10% to 100% of maximum rated input value |
| | Operating value | 100% operation at set value |
| Reset (HYS.) | Hysteresis | 5% of operating value (fixed) |
| | Resetting method | Manual reset/automatic reset (switchable) Manual reset: Turn OFF operating power for 1 s or longer. |
| Operating time (T) | | 0.1 to 30 s (Value when input rapidly changes from 0% to 120%.) |
| Power ON lock (LOCK) | | 1 s or 5 s error ± 0.5 s (Value when input rapidly changes from 0% to 100%. The operating time is the shortest at this point.) |
| Setting accuracy | | $\pm 10\%$ of full scale |
| Time error | | $\pm 10\%$ of set value (Minimum error: 50 ms) |
| Input frequency | | 40 to 500 Hz |
| Input impedance | | K8AB-VW1: 9 k Ω min. K8AB-VW2: 100 k Ω min. K8AB-VW3: 1 M Ω min. |
| Indicators | | Power (PWR): Green LED, Relay output (RY): Yellow LED, Alarm outputs (ALM1/2): Red LED |
| Output relays | | Two SPDT relays (6 A at 250 VAC, resistive load), Normally closed operation (normally ON) (separate outputs possible for overvoltages and undervoltages) |


■ Specifications

| | | |
|---|-----------------------------------|--|
| Ambient operating temperature | | –20 to 60°C (with no condensation or icing) |
| Storage temperature | | –40 to 70°C (with no condensation or icing) |
| Ambient operating humidity | | 25% to 85% |
| Storage humidity | | 25% to 85% |
| Altitude | | 2,000 m max. |
| Operating voltage range | | 85% to 110% of rated operating voltage |
| Rated power supply frequency | | 50/60 Hz \pm 5 Hz (AC power supply) |
| Output relays | Resistive load | 6 A at 250 VAC ($\cos \phi = 1$) 6 A at 30 VDC (L/R = 0 ms) |
| | Inductive load | 1 A at 250 VAC ($\cos \phi = 0.4$) 1 A at 30 VDC (L/R = 7 ms) |
| | Minimum load | 10 mA at 5 VDC |
| | Maximum contact voltage | 250 VAC |
| | Maximum contact current | 6 A AC |
| | Maximum switching capacity | 1,500 VA |
| | Mechanical life | 10,000,000 operations |
| | Electrical life | Make: 50,000 times, Break: 30,000 times |
| Terminal screw tightening torque | | 1.2 N·m |
| Crimp terminals | | Two solid wires of 2.5 mm ² , two crimp terminals of 1.5 mm ² with insulation sleeves, can be tightened together |
| Insulation resistance | | 20 M Ω (at 500 V) between charged terminals and exposed uncharged parts 20 M Ω (at 500 V) between any charged terminals (i.e., between input, output, and power supply terminals) |
| Degree of protection | | Terminal section: IP20, Rear case: IP40 |
| Case color | | Munsell 5Y8/1 (ivory) |
| Case material | | ABS resin (self-extinguishing resin) UL94-V0 |
| Weight | | 200 g |
| Mounting | | Mounted to DIN-rail or via M4 screws |
| Dimensions | | 22.5 (W) x 90 (H) x 100 (D) mm |
| Installation environment | | Overvoltage Category III, Pollution Degree 2 |
| Application standards | | EN60255-5/-6 |
| Safety standards | | EN60664-1 |
| EMC | | EMI: EN61326 Industrial applications Electromagnetic interference wave CISPR11 Group 1, Class A: CISPR16-1/-2 Terminal interference wave voltage CISPR11 Group 1, Class A: CISPR16-1/-2 EMS: EN61326 Industrial applications Electrostatic discharge EN61000-4-2: 8 kV (in air) Radiating radio-frequency electromagnetic field EN61000-4-3: 10 V/m 1 kHz sine wave amplitude modulation (80 MHz to 1 GHz) Burst EN61000-4-4: 1 kV (I/O signal line), 2 kV (power line) Surge EN61000-4-5: 1 kV with line (power line), 2 kV with ground (power line) Conducted RF EN61000-4-6: 3 V (0.15 to 80 MHz) Power frequency magnetic field immunity EN61000-4-8: 30 A/m Voltage dip/short interruptions EN61000-4-11: 0.5 cycle, 0.180° each, polarity 100% (rated voltage) |


Connections

■ Wiring Diagram


Overvoltage and Undervoltage Operation Diagram

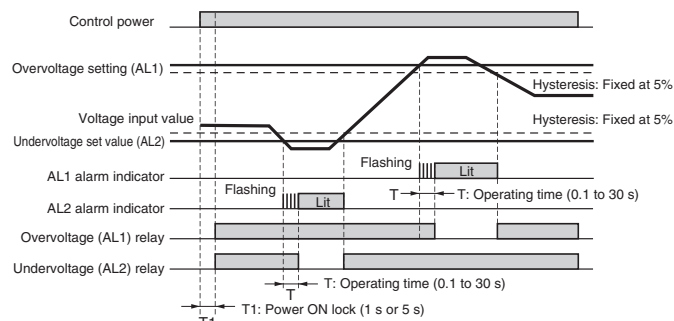

- Note:**
1. The K8AB-VW output relay is normally operative.
 2. The power ON lock prevents unnecessary alarms from being generated during the instable period when the power is first turned on. There is no relay output during timer operation.

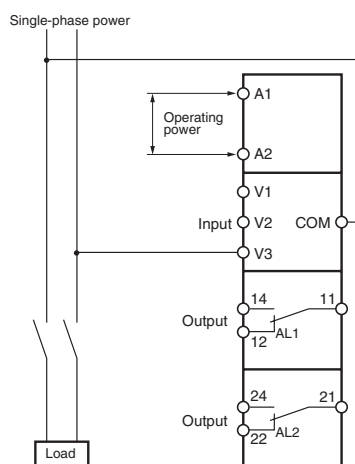


Overvoltage and Undervoltage Operation Diagram (Overvoltage Pre-alarm Mode)

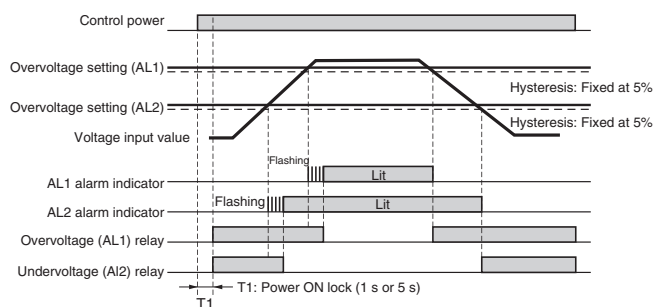

- Note:**
1. The K8AB-VW output relay is normally operative.
 2. The power ON lock prevents unnecessary alarms from being generated during the instable period when the power is first turned on. There is no relay output during timer operation.

Overvoltage and Undervoltage Operation Diagram (Undervoltage Pre-alarm Mode)

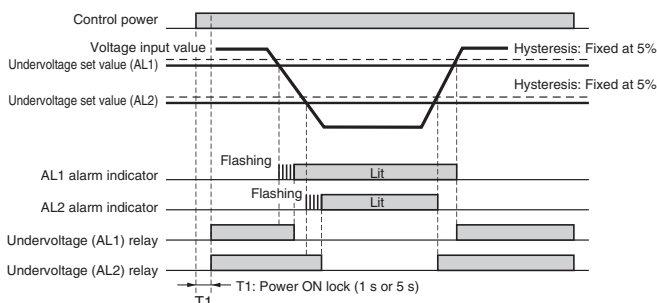


- Note:**
1. The K8AB-VW output relay is normally operative.
 2. The power ON lock prevents unnecessary alarms from being generated during the instable period when the power is first turned on. There is no relay output during timer operation.

| Model | Measuring range | Connection |
|----------|--------------------|------------|
| K8AB-VW1 | 6 to 60 mV AC/DC | V1-COM |
| | 10 to 100 mV AC/DC | V2-COM |
| | 30 to 300 mV AC/DC | V3-COM |
| K8AB-VW2 | 1 to 10 V AC/DC | V1-COM |
| | 3 to 30 V AC/DC | V2-COM |
| | 15 to 150 V AC/DC | V3-COM |
| K8AB-VW3 | 20 to 200 V AC/DC | V1-COM |
| | 30 to 300 V AC/DC | V2-COM |
| | 60 to 600 V AC/DC | V3-COM |

Nomenclature

Front

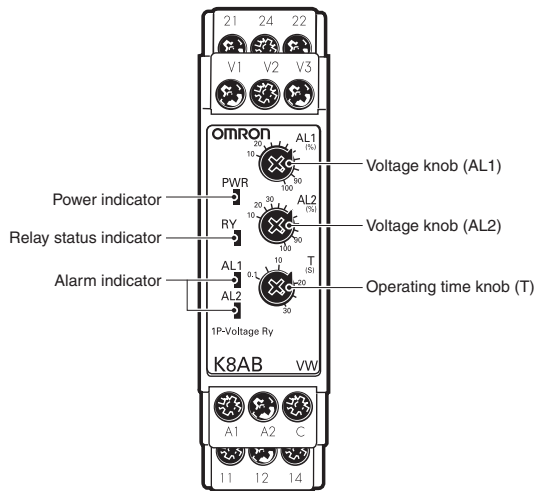


Indicators

| Item | Meaning |
|-------------------------------------|---|
| Power indicator (PWR: Green) | Lit when power is being supplied. |
| Relay status indicator (RY: Yellow) | Lit when relay operates (Not light when both AL1 and AL2 are in error status) (Normally lit) |
| Alarm indicators (AL1 and AL2: Red) | Lit when there is an overvoltage or undervoltage. The indicator flashes to indicate the error status after the input has exceeded the threshold value while the operating time is being clocked. |

Setting Knobs

| Item | Usage |
|-------------------------|--|
| Voltage knob (AL1) | Used to set the voltage to 10% to 100% of maximum rated input voltage. |
| Voltage knob (AL2) | Used to set the voltage to 10% to 100% of maximum rated input voltage. |
| Operating time knob (T) | Used to set the operating time to 0.1 to 30 s. |

Function Selection DIP Switch

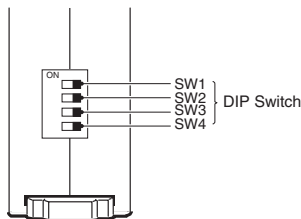


DIP Switch Functions

| | | Function | | Default | |
|-----|------------------------------|----------------|--------------------------------------|---------|-----|
| SW1 | Operating power ON lock time | OFF | 1 s | OFF | |
| | | ON | 5 s | | |
| SW2 | Resetting method | OFF | Manual reset | OFF | |
| | | ON | Automatic reset | | |
| SW3 | SW4 | Function | | Default | |
| | | | | SW3 | SW4 |
| OFF | OFF | Operating mode | AL1: Overvoltage, AL2: Undervoltage | OFF | OFF |
| ON | OFF | | AL1: Overvoltage, AL2: Overvoltage | | |
| OFF | ON | | AL1: Undervoltage, AL2: Undervoltage | | |
| ON | ON | | AL1: Overvoltage, AL2: Undervoltage | | |

Dimensions

K8AB-VW

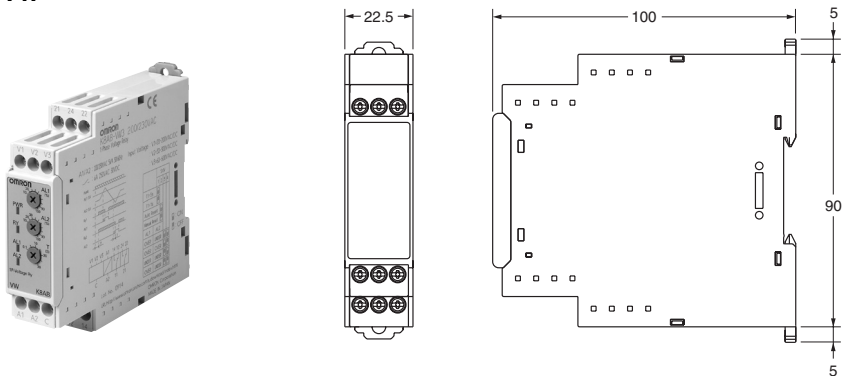

Safety Precautions

■ Precautions for Safe Use

Make sure to follow the instructions below to ensure safety.

1. Do not use or keep this product in the following environments.
 - Outdoors, or places subject to direct sunlight or wearing weather.
 - Places where dust, iron powder, or corrosive gases (in particular, sulfuric or ammonia gas) exist.
 - Places subject to static electricity or inductive noise.
 - Places where water or oil come in contact with the product.
2. Make sure to install this product in the correct direction.
3. There is a remote risk of electric shock. Do not touch terminals while electricity is being supplied.
4. Make sure to thoroughly understand all instructions in the Instructions Manual before handling this product.
5. Make sure to confirm terminal makings and polarity for correct wiring.
6. Tighten terminal screws firmly using the following torque.
Recommended torque: 0.54 N·m
7. Operating ambient temperature and humidity for this product must be within the indicated rating when using this product.
8. There is a remote risk of explosion. Do not use this product where flammable or explosive gas exists.
9. Make sure that no weight rests on the product after installation.
10. To enable an operator to turn off this product easily, install switches or circuit breakers that conform to relevant requirements of IEC60947-1 and IEC60947-3, and label them appropriately.
11. For DC input, use a SELV power-supply capable of overcurrent protection. Specifically, a SELV power-supply has a double or reinforced insulation for input and output, and output voltage of 30 V_{r.m.s} with 42.4 V at peak or DC60V maximum.
Recommended power-supply: Model S8VS-06024□□. (Omron product)

■ Precautions for Correct Use

For Proper Use

1. Do not use the product in the following locations.
 - Places subject to radiant heat from heat generating devices.
 - Places subject to vibrations or physical shocks.
2. Make sure to use setting values appropriate for the controlled object. Failure to do so can cause unintended operation, and may result in accident or corruption of the product.
3. Do not use thinner or similar solvent for cleaning. Use commercial alcohol.
4. When discarding, properly dispose of the product as industrial waste.
5. Only use this product within a board whose structure allows no possibility for fire to escape.

About Installation

1. When wiring, use only recommended crimp terminals.
2. Do not block areas around the product for proper dissipation of heat. (If you do not secure space for heat dissipation, life cycle of the product will be compromised.)
3. To avoid electrical shocks, make sure that power is not supplied to the product while wiring.
4. To avoid electrical shocks, make sure that power is not supplied to the product when performing DIP switch settings.

Noise Countermeasures

1. Do not install the product near devices generating strong high frequency waves or surges.
2. When using a noise filter, check the voltage and current and install it as close to the product as possible.
3. In order to prevent inductive noise, wire the lines connected to the product separately from power lines carrying high voltages or currents. Do not wire in parallel with or on the same cable as power lines.
Other measures for reducing noise include running lines along separate ducts and using shield lines.

To avoid faulty operations, malfunctions, or failure, observe the following operating instructions.

1. When turning on the power, make sure to realize rated voltage within 1 second from the time of first supply of electricity.
2. Make sure to use power supply for operations, inputs, and transformer with the appropriate capacity and rated burden.
3. Maintenance and handling of this product may only be performed by qualified personnel.
4. Distortion ratio of input wave forms must be 30% or less. Use of this product with circuits that have large distortion in wave forms may result in unwanted operations.
5. Using this product for thyristor controls or inverters will result in errors.
6. When setting the volume, adjust the control from the minimum side to the maximum side.

Warranty and Application Considerations

Read and Understand this Catalog

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

Warranty and Limitations of Liability

WARRANTY

OMRON's exclusive warranty is that the products are free from defects in materials and workmanship for a period of one year (or other period if specified) from date of sale by OMRON.

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, REGARDING NON-INFRINGEMENT, MERCHANTABILITY, OR FITNESS FOR PARTICULAR PURPOSE OF THE PRODUCTS. ANY BUYER OR USER ACKNOWLEDGES THAT THE BUYER OR USER ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. OMRON DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED.

LIMITATIONS OF LIABILITY

OMRON SHALL NOT BE RESPONSIBLE FOR SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS, OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED ON CONTRACT, WARRANTY, NEGLIGENCE, OR STRICT LIABILITY.

In no event shall the responsibility of OMRON for any act exceed the individual price of the product on which liability is asserted.

IN NO EVENT SHALL OMRON BE RESPONSIBLE FOR WARRANTY, REPAIR, OR OTHER CLAIMS REGARDING THE PRODUCTS UNLESS OMRON'S ANALYSIS CONFIRMS THAT THE PRODUCTS WERE PROPERLY HANDLED, STORED, INSTALLED, AND MAINTAINED AND NOT SUBJECT TO CONTAMINATION, ABUSE, MISUSE, OR INAPPROPRIATE MODIFICATION OR REPAIR.

Application Considerations

SUITABILITY FOR USE

OMRON shall not be responsible for conformity with any standards, codes, or regulations that apply to the combination of products in the customer's application or use of the products.

Take all necessary steps to determine the suitability of the product for the systems, machines, and equipment with which it will be used. Know and observe all prohibitions of use applicable to this product.

NEVER USE THE PRODUCTS FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCTS ARE PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

Disclaimers

PERFORMANCE DATA

Performance data given in this catalog is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of OMRON's test conditions, and the users must correlate it to actual application requirements. Actual performance is subject to the OMRON *Warranty and Limitations of Liability*.

CHANGE IN SPECIFICATIONS

Product specifications and accessories may be changed at any time based on improvements and other reasons. Consult with your OMRON representative at any time to confirm actual specifications of purchased product.

DIMENSIONS AND WEIGHTS

Dimensions and weights are nominal and are not to be used for manufacturing purposes, even when tolerances are shown.

ALL DIMENSIONS SHOWN ARE IN MILLIMETERS.

To convert millimeters into inches, multiply by 0.03937. To convert grams into ounces, multiply by 0.03527.